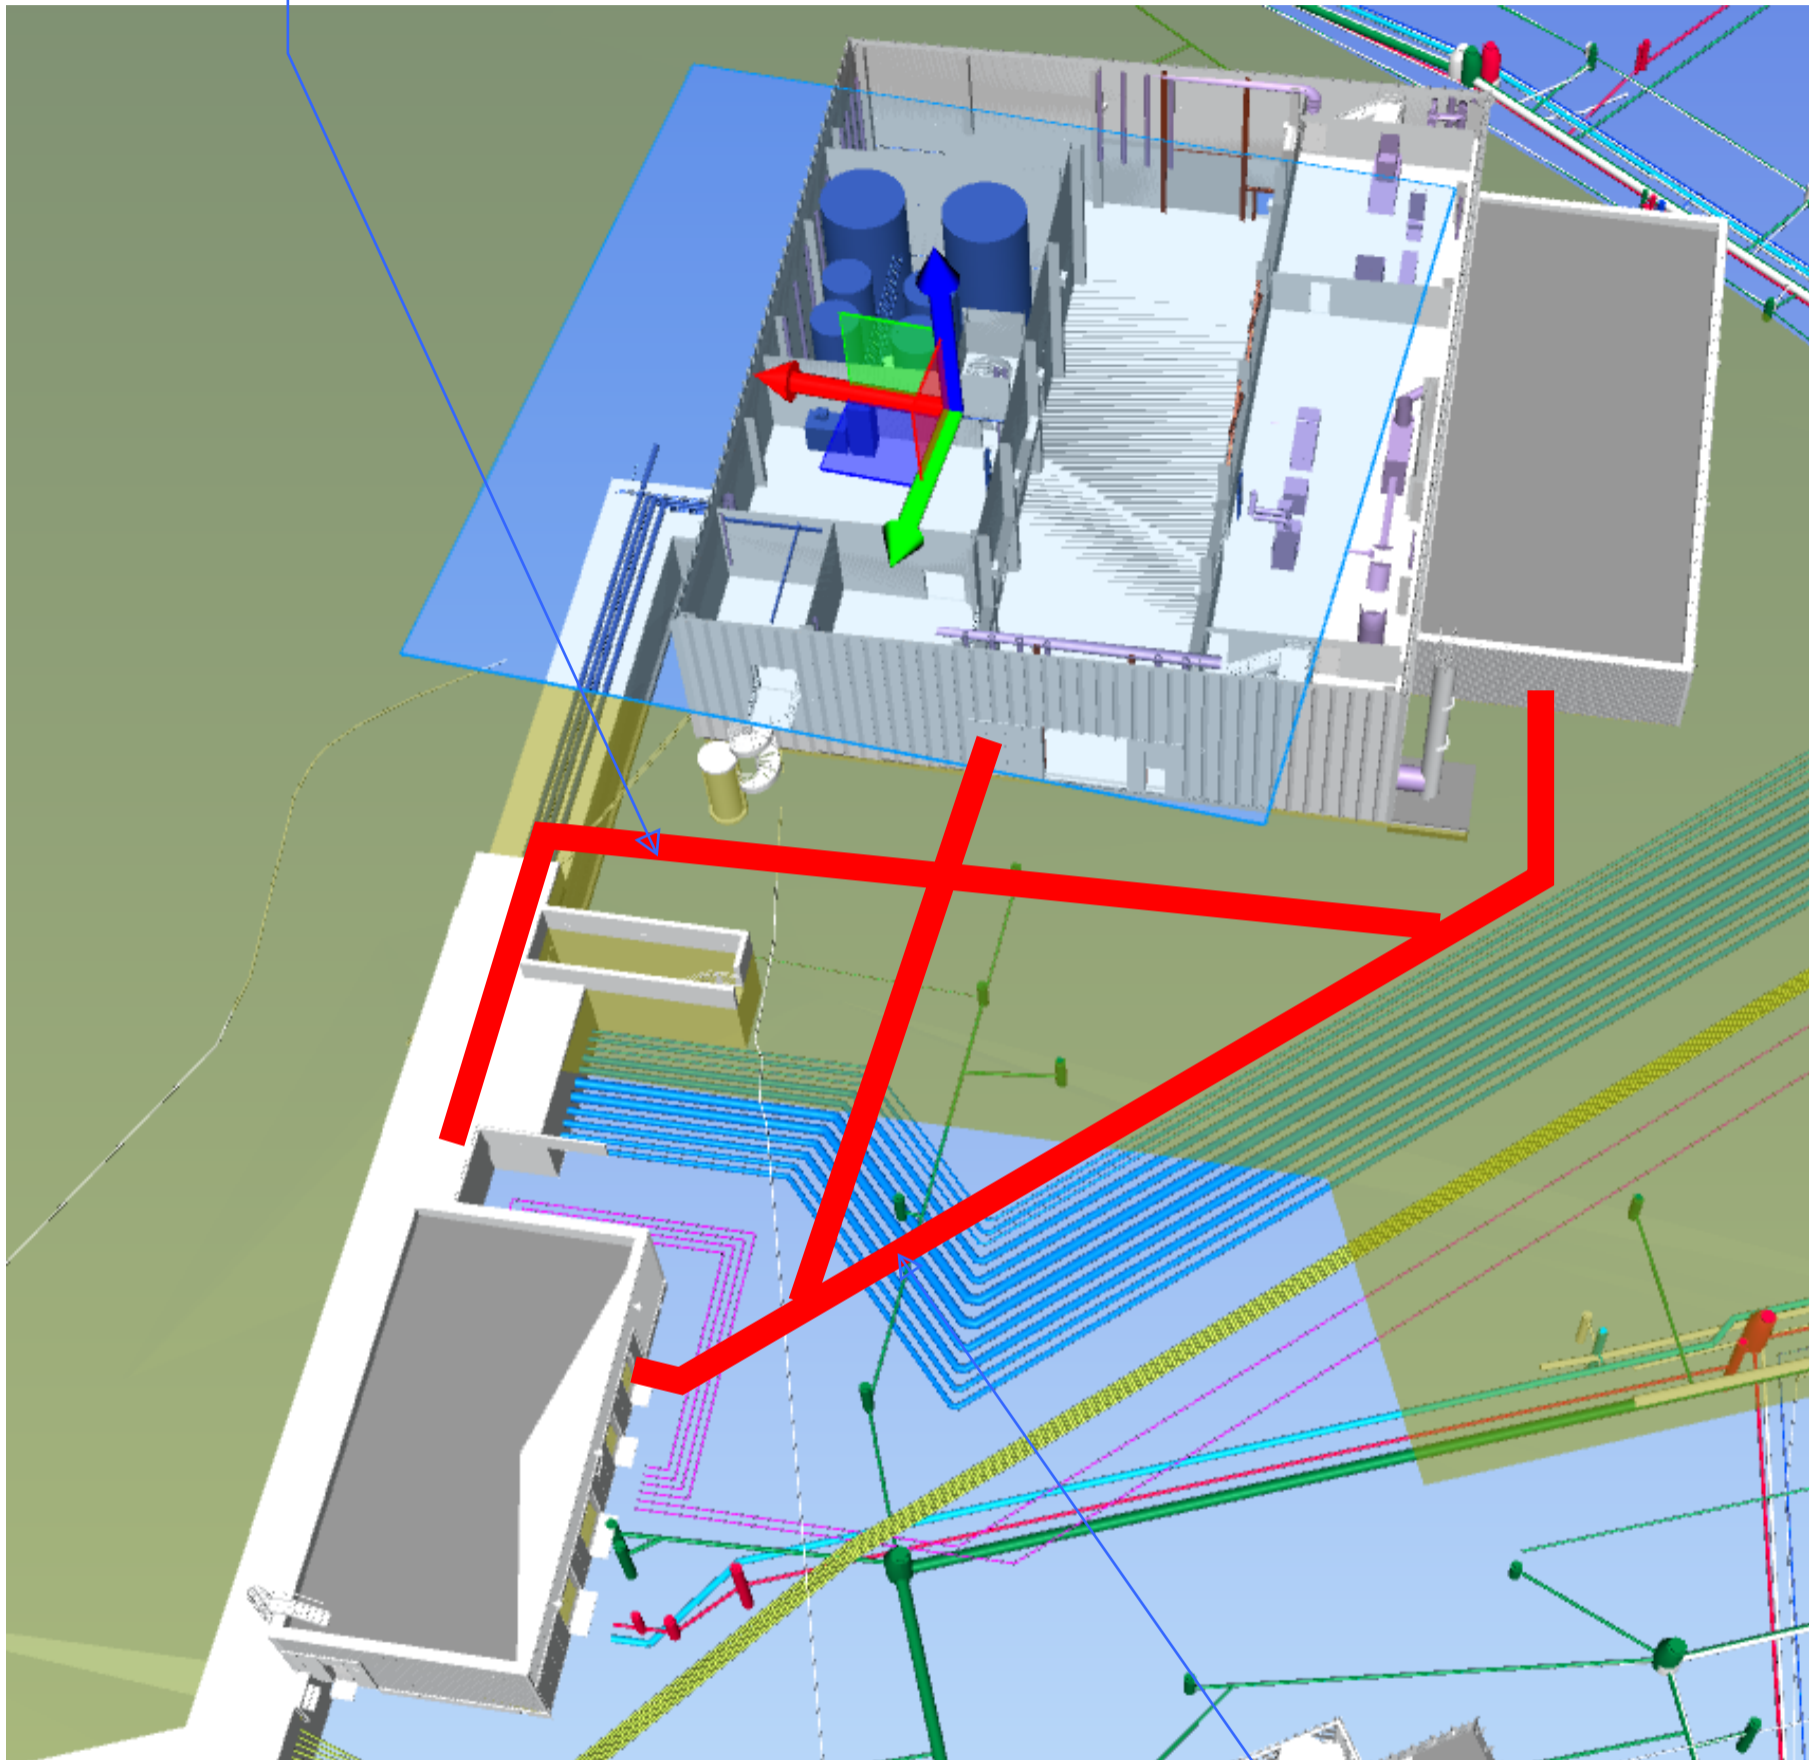

DM--DT-DEPDDDH09-ELECTRICAL DUCTING GROUND.pdf

	Name	Role/Title
Owner	Per Pihl	Electrical Designer
Reviewer	Magnus Leonardsson	ELV System owner
	Ronny Sjöholm	MEP Advisor
Approver	Boris Kildetoft	Building Owner

ALTERNATIVE
CONDUITS ENDS UP IN
INSTALLATION
GALLERY. CABLE
LADDER IN GALLERY TO
LV ROOM IN D05



ALTERNATIVE
CONDUITS ENDS UP IN
INSTALLATION FLOOR
LV ROOM D05.
CROSSING PROCESS
PIPES IN GROUND

Review comments to this document are made in
ESS-0154140

PRELIMINARY DESIGN
H09 WASTE BUILDING

ÅF INFRASTRUCTURE AB

PER PIHL
2017-12-12

SKETCH DUCTING GROUND

ESS-0206993